


Graph of ETV Test Sediment PSD as prepared by Joe Costa of GHIL, and forwarded in an email received from Joe Costa 24March2015.

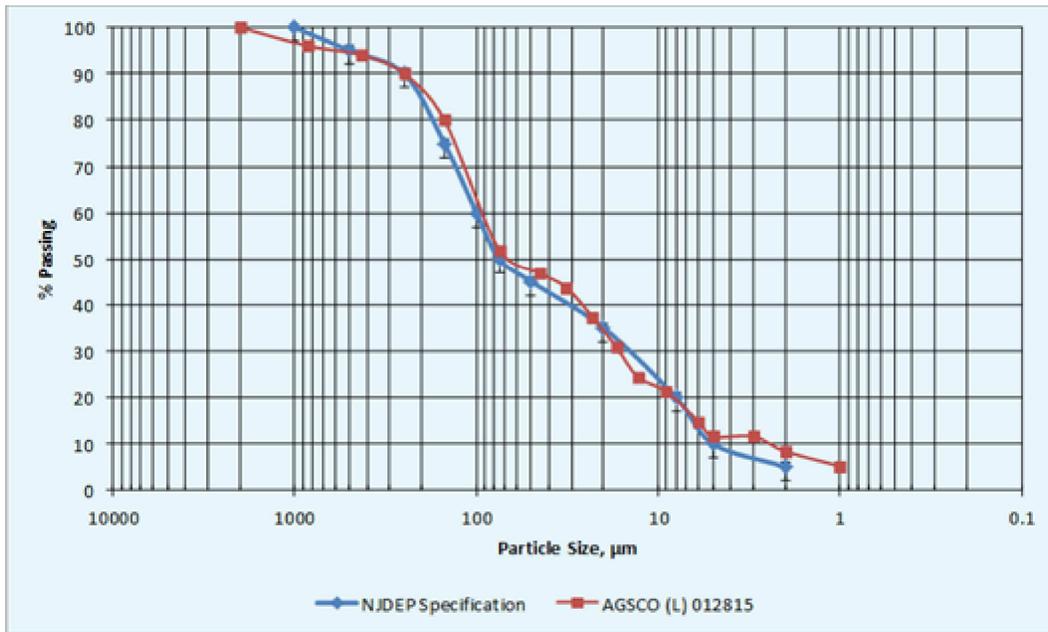

Joe Costa indicates in his email that “this batch has a d50 of just under 75 µm and falls within the allowed variance at every specified particle size (though it is a close call at 1000 µm).”